

**SPECIFICATION****For****8.7/15KV-CV**

8.7/15(17.5)kV XLPE Insulated

PVC Sheathed Power Cable

(8.7/15(17.5)kV, Cu/XLPE/CTS/PVC)

BY



(Wachara Sangsomritphon)

MANAGER, Cable Design Section

APP.



(Winai Ariyasakulsap)

MANAGER, Development Department

APP. \_\_\_\_\_

( )

CUSTOMER

Rev.	Date	Description
0	27/01/2020	Issued specification
1	26/03/2021	Cancel code "(0010)"
2	12/7/2021	Correct the value in Table 1

Customer Document	Rev.

**Remark:**

This document is based on the Customer Document for the structure and properties of electric wire and cable only. If there are different points, will be shown in deviation table.

## **1. Scope**

This specification covers 16500V copper conductor cross-linked polyethylene (XLPE) insulated polyvinyl chloride (PVC) sheathed power cable.

The cable shall be in accordance with IEC 60502-2 : 2014.

The finished cables shall meet the flame test requirements per IEC 60332-1.

## **2. Conductor**

The conductor shall be compacted concentric stranded uncoated annealed copper conductor in accordance with IEC 60228 : 2004, Class 2.

The direction of lay shall be left-hand (S) lay in the outermost layer.

## **3. Conductor Shield**

The conductor shield shall be a semi-conducting nylon tape and shall be applied helically with a wrap over the conductor and a layer of extruded semi-conducting compound.

Size  $\leq 150 \text{ mm}^2$  : Applied extruded semi-conducting compound

Size  $\geq 185 \text{ mm}^2$  : Applied semi-conducting nylon tape and extruded semi-conducting compound

The thickness of the conductor shield shall be approximate 0.5 mm.

## **4. Insulation**

The insulation shall be cross-linked polyethylene (XLPE) compound meet the requirements of IEC 60502-2 : 2014.

The average thickness of the insulation shall be not less than that given in Table 1.

The minimum thickness shall not fall below the value in Table 1 by more than 10% plus 0.1 mm.

The thickness of insulation shall not be included that of conductor shield.

## **5. Insulation Shield**

The insulation shield shall be a layer of extruded semi-conducting compound and shall be free stripping.

The thickness of the insulation shield shall be approximate 0.5 mm.

## **6. Metallic Shield**

The metallic shield shall be an uncoated annealed copper tape and shall be applied helically with a lap over the insulation shield.

The thickness of the copper tape shall be approximate 0.1 mm.

A suitable separator tape shall be applied helically over the shielded core for single-core only.

## **7. Cabling (For multi-cores only)**

The individual shielded cores shall be cabled together with suitable non-hygroscopic filler to give the completed cable a substantially circular cross section.

The direction of lay shall be left-hand (S) lay.

A suitable binder tape shall be applied helically over the cabled core.

## **8. Core Identification**

The cores shall be identified by colors of identification tape, placed longitudinally under the metallic shield, as follow :

Single-core : Not inserted color of identification tape

3-cores : white, red, blue

## **9. Sheath**

The sheath shall be sunlight resistant polyvinyl chloride (PVC/ST2) compound meet the requirements of IEC 60502-2 : 2014.


The average thickness of the sheath shall be not less than that given in Table 1.

The minimum thickness shall not fall below the value in Table 1 by more than 20% plus 0.2 mm.

The color of the sheath shall be black.

## **10. Marking on Cable**

The marking items shall be marked with suitable means throughout the length of cable.

1. Manufacturer's name and/or trade mark "  YAZAKI..... : TYE"

2. Year of manufacture

3. Rated circuit voltage "8.7/15(17.5)KV"

4. Type of insulation "XLPE"

5. Type of cable "POWER CABLE"

6. Number of cores and size of conductor

7. The continuous reel length marking (in figure) shall be made on the sheath at every 1 meter

## **11. Test and Properties**

The cable shall meet the requirements in Test and Inspection and Table 1, when tested in accordance with IEC 60502-2 : 2014, IEC 60228 : 2004 and IEC 60332-1.


Remark: Sunlight resistant test meet the requirement of TIS 293-2541.

## 12. Packing

The cable shall be placed on non-returnable wooden reels.

The reels shall be covered with suitable covering to provide the cable with physical protection during transportation and during ordinary storage and handling operations.

Each reel shall be clearly marked as follows.

1. Designation "8.7/15KV-CV"
2. Number of cores and size of conductor
3. Cable length
4. Net and gross weight
5. Manufacturer's name and/or trade mark "  **YAZAKI** "
6. Rolling direction of reel

## Test and Inspection

### Routine Tests

- Maximum conductor resistance, Ohm/km.....specified in Table 1
- AC test voltage for 5 minutes, kV.....30.5
- Maximum partial discharge level\*.....10 pC or better, at 15.05 kV
- Electrical test on over sheath .....No breakdown

\*The partial discharge level shall be no detectable discharge exceeding the declared sensitivity

### Sample Tests

- Construction.....specified in Table 1
- AC test voltage for 4 hours, kV.....35
- Hot set test at  $200\text{ }^{\circ}\text{C} \pm 3\text{ }^{\circ}\text{C}$  for XLPE
  - Maximum elongation under load (%) .....175
  - Maximum permanent elongation after cooling (%).....15

### Type Tests

- Flame retardant tested according to IEC 60332-1

### Definition concerning the tests


**Routine tests:** Tests made by the manufacturer on each manufactured length of cable to check that each length meets the specified requirements.

**Sample tests:** Tests made by the manufacturer on samples of completed cable or components taken from a completed cable, at a specified frequency, so as to verify that the finished product meets the specified requirements.


**Type tests:** Tests made before supplying, on a general commercial basis, a type of cable covered by this standard, in order to demonstrate satisfactory performance characteristics to meet the intended application.

### Cable structure

Cross-sectional (Not scale)

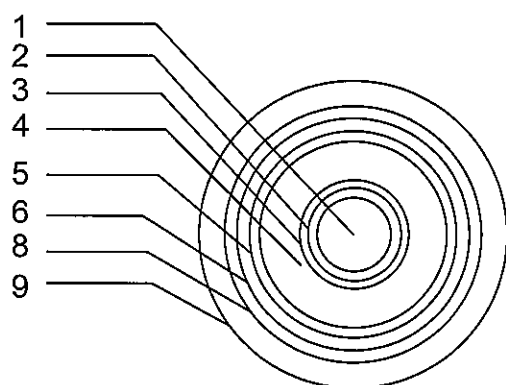

Single-core

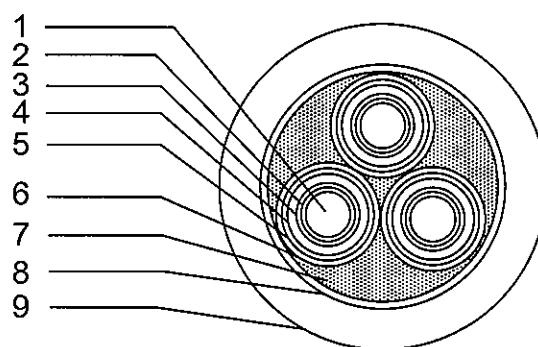

Multi-core

No.	Structure	Material
1	Conductor	Compacted concentric stranded annealed copper
2	Nylon tape	Semi-conducting nylon tape (if necessary)
3	Conductor shield	Semi-conducting compound
4	Insulation	Cross-Linked Polyethylene (XLPE)
5	Insulation shield	Semi-conducting compound
6	Metallic shield	Copper tape
7	Filler	PP calcium yarn (Non-hygroscopic)
8	Binder tape or separator tape	Spun bond tape or suitable tape
9	Sheath	Polyvinyl chloride (PVC/ST2)

**Application:** Use for installation exposed, or in raceway, wet or dry location, or direct burial in ground.

Maximum conductor temperature of 90°C for normal operation and 250°C for short circuit conditions

**Table 1**

No. of core	Size (mm <sup>2</sup> )	Conductor (wires/type)	Conductor diameter approx. (mm)	Insulation thickness nominal (mm)	Sheath thickness nominal (mm)	Overall diameter approx. (mm)	Conductor resistance at 20°C maximum (Ohm/km)	Weight of cable approx. (kg/km)	Standard packing length (m)
1	25	7/Compacted	6.00	4.5	1.6	22.5	0.727	650	500
1	35	7/Compacted	7.10	4.5	1.7	24.0	0.524	750	500
1	50	19/Compacted	8.30	4.5	1.7	25.0	0.387	900	500
1	70	19/Compacted	9.90	4.5	1.8	27.0	0.268	1100	500
1	95	19/Compacted	11.70	4.5	1.8	28.5	0.193	1400	500
1	120	37/Compacted	13.20	4.5	1.9	30.5	0.153	1700	500
1	150	37/Compacted	14.60	4.5	1.9	32.0	0.124	2000	500
1	185	37/Compacted	16.30	4.5	2.0	34.0	0.0991	2400	500
1	240	61/Compacted	18.70	4.5	2.1	36.5	0.0754	3000	500
1	300	61/Compacted	20.90	4.5	2.1	39.0	0.0601	3700	500
1	400	61/Compacted	23.50	4.5	2.2	41.5	0.0470	4500	500
1	500	61/Compacted	26.70	4.5	2.3	45.5	0.0366	5500	500
1	630	61/Compacted	30.30	4.5	2.4	49.5	0.0283	7000	500
1	800	61/Compacted	34.10	4.5	2.6	53.5	0.0221	8500	500
1	1000	127/Compacted	39.50	4.5	2.7	59.0	0.0176	11500	300

**Table 1 (Continued)**

No. of cores	Size (mm <sup>2</sup> )	Conductor (wires/type)	Conductor diameter approx. (mm)	Insulation thickness nominal (mm)	Sheath thickness nominal (mm)	Overall diameter approx. (mm)	Conductor resistance at 20°C maximum (Ohm/km)	Weight of cable approx. (kg/km)	Standard packing length (m)
3	25	7/Compacted	6.00	4.5	2.4	46.0	0.727	2100	500
3	35	7/Compacted	7.10	4.5	2.5	48.5	0.524	2500	500
3	50	19/Compacted	8.30	4.5	2.6	51.0	0.387	3000	500
3	70	19/Compacted	9.90	4.5	2.7	55.0	0.268	3700	500
3	95	19/Compacted	11.70	4.5	2.8	59.0	0.193	4700	500
3	120	37/Compacted	13.20	4.5	2.9	62.5	0.153	5500	500
3	150	37/Compacted	14.60	4.5	3.1	66.0	0.124	6500	500
3	185	37/Compacted	16.30	4.5	3.2	70.5	0.0991	8000	300
3	240	61/Compacted	18.70	4.5	3.4	76.5	0.0754	9500	300
3	300	61/Compacted	20.90	4.5	3.5	81.5	0.0601	11500	300
3	400	61/Compacted	23.50	4.5	3.7	87.5	0.0470	14500	300



**Table 1 (Continued)**

No. of cores	Size (mm <sup>2</sup> )	Continuous current rating in free air at 40°C maximum (A)	Continuous current rating in ground at 30°C maximum (A)
1	25	177	140
1	35	215	167
1	50	258	197
1	70	322	240
1	95	394	288
1	120	454	327
1	150	517	367
1	185	595	414
1	240	705	480
1	300	805	539
1	400	935	611
1	500	1093	693
1	630	1272	780
1	800	1460	864
1	1000	1669	945

**Table 1 (Continued)**

No. of cores	Size (mm <sup>2</sup> )	Continuous current rating in free air at 40°C maximum (A)	Continuous current rating in ground at 30°C maximum (A)
3	25	142	137
3	35	173	165
3	50	208	195
3	70	258	238
3	95	314	284
3	120	362	323
3	150	409	361
3	185	468	407
3	240	551	470
3	300	629	529
3	400	722	598