

SPECIFICATION

For

6/10KV-CV-CWS

6/10(12)kV XLPE Insulated

PVC Inner Sheathed Copper Wire Screened

PVC Outer Sheathed Power Cable

(6/10(12)kV, Cu/XLPE/CTS/PVC/CWS/PVC)

BY Wachara
(Wachara Sangsomritphon)

MANAGER, Cable Design Section

APP. Winai Ariyasakulsap
(Winai Ariyasakulsap)
MANAGER, Development Department

Rev.	Date	Description
0	28/3/2022	Issued specification

APP. _____
()
CUSTOMER

Customer Document	Rev.

Remark:

This document is based on the Customer Document for the structure and properties of electric wire and cable only. If there are different points, will be shown in deviation table.

1. Scope

This specification covers 11000V copper conductor cross-linked polyethylene (XLPE) insulated polyvinyl chloride (PVC) inner sheathed copper wire screened polyvinyl chloride (PVC) outer sheathed power cable.

The cable shall be in accordance with IEC 60502-2 : 2014.

2. Conductor

The conductor shall be compacted concentric stranded uncoated annealed copper conductor in accordance with IEC 60228 : 2004, Class 2.

The direction of lay shall be left-hand (S) lay in the outermost layer.

3. Conductor Shield

The conductor shield shall be a semi-conducting nylon tape and shall be applied helically with a wrap over the conductor and a layer of extruded semi-conducting compound.

Size $\leq 150 \text{ mm}^2$: Applied extruded semi-conducting compound

Size $\geq 185 \text{ mm}^2$: Applied semi-conducting nylon tape and extruded semi-conducting compound

The thickness of the conductor shield shall be approximate 0.5 mm.

4. Insulation

The insulation shall be cross-linked polyethylene (XLPE) compound meet the requirements of IEC 60502-2 : 2014.

The average thickness of the insulation shall be not less than that given in Table 2.

The minimum thickness shall not fall below the value in Table 2 by more than 10% plus 0.1 mm.

The thickness of insulation shall not be included that of conductor shield.

5. Insulation Shield

The insulation shield shall be a layer of extruded semi-conducting compound and shall be free stripping.

The thickness of the insulation shield shall be approximate 0.5 mm.

6. Metallic Shield (For multi-cores only)

The metallic shield shall be an uncoated annealed copper tape and shall be applied helically with a lap over the insulation shield.

The thickness of the copper tape shall be approximate 0.1 mm.

7. Cabling (For multi-cores only)

The individual shielded cores shall be cabled together with suitable non-hygroscopic filler to give the completed cable a substantially circular cross section.

The direction of lay shall be left-hand (S) lay.

A suitable binder tape shall be applied helically over the cabled core.

8. Core Identification

The cores shall be identified by colors of identification tape, placed longitudinally under the metallic shield, as follow :

Single-core : Not inserted color of identification tape

3-cores : white, red, blue

9. Inner Sheath (For multi-cores only)

The inner sheath shall be polyvinyl chloride (PVC) compound applied over the binder tape.

The approximate thickness given in Table 1.

The color of the inner sheath shall be black.

10. Copper Wire Screen

The copper wire screen shall consist of plain annealed round copper wires applied helically over the insulation shield for single-core or inner sheathed for multi-core.

The contact tape shall be an annealed uncoated copper tape and shall be applied helically with a gap over the copper wire screen.

The thickness of the copper tape shall be approximate 0.1 mm.

A suitable separator tape shall be applied helically over the contacted tape.

10. Outer Sheath

The outer sheath shall be sunlight resistant polyvinyl chloride (PVC/ST2) compound meet the requirements of IEC 60502-2 : 2014.


The average thickness of the outer sheath shall be not less than that given in Table 2.

The minimum thickness shall not fall below the value in Table 2 by more than 20% plus 0.2 mm.

The color of the outer sheath shall be black.

11. Marking on Cable

The marking items shall be marked with suitable means throughout the length of cable.

1. Manufacturer's name and/or trade mark "  YAZAKI..... : TYE"
2. Year of manufacture
3. Rated circuit voltage "6/10(12)KV"
4. Type of insulation "XLPE"
5. Type of cable "POWER CABLE"
6. Number of cores and size of conductor
7. The continuous reel length marking (in figure) shall be made on the outer sheath at every 1 meter

12. Test and Properties

The cable shall meet the requirements in Test and Inspection and Table 1, when tested in accordance with IEC 60502-2 : 2014, IEC 60228 : 2004 and IEC 60332-1.


Remark: Sunlight resistant test meet the requirement of TIS 293-2541.

13. Packing

The cable shall be placed on non-returnable wooden reels.

The reels shall be covered with suitable covering to provide the cable with physical protection during transportation and during ordinary storage and handling operations.

Each reel shall be clearly marked as follows.

1. Designation "6/10KV-CV-CWS"
2. Number of cores and size of conductor
3. Cable length
4. Net and gross weight
5. Manufacturer's name and/or trade mark "  **YAZAKI** "
6. Rolling direction of reel

Test and Inspection

Routine Tests

- Maximum conductor resistance, Ohm/km.....specified in Table 1
- AC test voltage for 5 minutes, kV.....21
- Maximum partial discharge level*.....10 pC or better, at 10.38 kV
- Electrical test on over sheathNo breakdown

*The partial discharge level shall be no detectable discharge exceeding the declared sensitivity

Sample Tests

- Construction.....specified in Table 1
- AC test voltage for 4 hours, kV.....24
- Hot set test at $200\text{ }^{\circ}\text{C} \pm 3\text{ }^{\circ}\text{C}$ for XLPE
 - Maximum elongation under load (%)175
 - Maximum permanent elongation after cooling (%).....15

Type Tests

- Flame retardant tested according to IEC 60332-1

Definition concerning the tests


Routine tests: Tests made by the manufacturer on each manufactured length of cable to check that each length meets the specified requirements.

Sample tests: Tests made by the manufacturer on samples of completed cable or components taken from a completed cable, at a specified frequency, so as to verify that the finished product meets the specified requirements.

Type tests: Tests made before supplying, on a general commercial basis, a type of cable covered by this standard, in order to demonstrate satisfactory performance characteristics to meet the intended application.

Cable structure

Cross-sectional (Not scale)

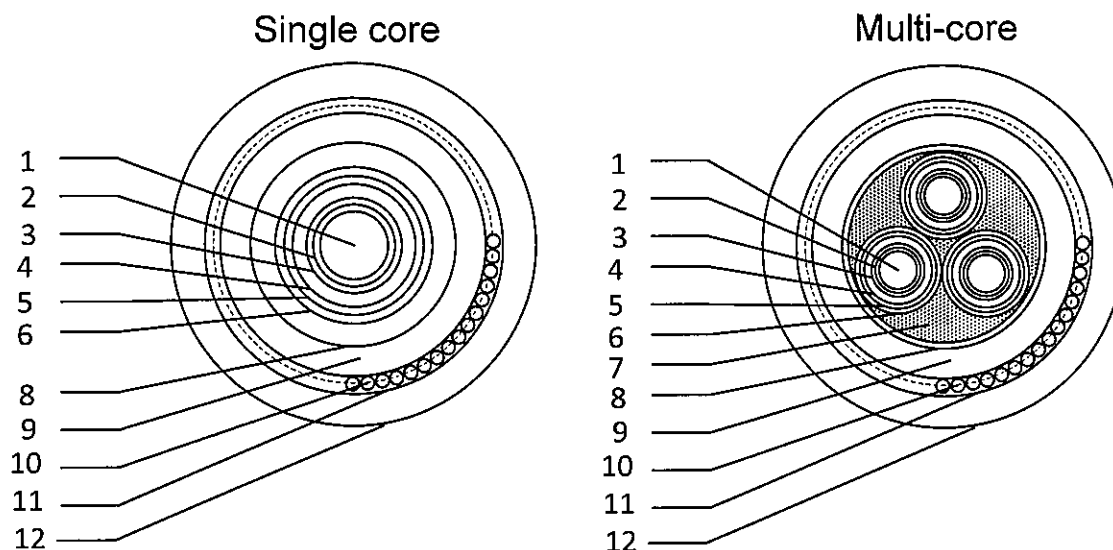

No.	Structure	Material
1	Conductor	Compacted concentric stranded annealed copper
2	Nylon tape	Semi-conducting nylon tape (For size $\geq 185 \text{ mm}^2$ only)
3	Conductor shield	Semi-conducting compound
4	Insulation	Cross-linked polyethylene (XLPE)
5	Insulation shield	Semi-conducting compound
6	Metallic shield	Copper tape
7	Filler	PP calcium yarn (Non-hygroscopic)
8	Binder tape	Spun bond tape or suitable tape
9	Inner sheath	Polyvinyl chloride (PVC)
10	Overall shield	Copper wire screen with copper contact tape
11	Binder	Spun bond tape or suitable tape
12	Outer sheath	Polyvinyl chloride (PVC/ST2)

Application: Use for installation exposed, or in raceway, wet or dry location, or direct burial in ground.

Maximum conductor temperature of 90°C for normal operation and 250°C for short circuit conditions

Table 1

No. of core	Size (mm ²)	Conductor (wire/type)	Conductor diameter approx. (mm)	Insulation thickness nominal (mm)	Copper wire area (mm ²)	Sheath thickness nominal (mm)	Overall diameter approx. (mm)	Conductor resistance at 20°C maximum (Ohm/km)	Weight of cable approx. (kg/km)	Standard packing length (m)
1	16/6	7/Compacted	4.80	3.4	6	1.8	21.0	1.15	500	500
1	25/6	7/Compacted	6.00	3.4	6	1.8	22.0	0.727	600	500
1	35/10	7/Compacted	7.10	3.4	10	1.8	23.0	0.524	750	500
1	50/10	19/Compacted	8.30	3.4	10	1.8	24.5	0.387	900	500
1	70/10	19/Compacted	9.90	3.4	10	1.8	26.0	0.268	1100	500
1	95/16	19/Compacted	11.70	3.4	16	1.8	28.5	0.193	1400	500
1	120/16	37/Compacted	13.20	3.4	16	1.9	30.0	0.153	1700	500
1	150/25	37/Compacted	14.60	3.4	25	1.9	31.5	0.124	2100	500
1	185/25	37/Compacted	16.30	3.4	25	2.0	34.0	0.0991	2500	500
1	240/35	61/Compacted	18.70	3.4	35	2.1	37.0	0.0754	3200	500
1	300/35	61/Compacted	20.90	3.4	35	2.2	39.5	0.0601	3800	500
1	400/35	61/Compacted	23.50	3.4	35	2.3	41.5	0.0470	4600	500

Table 1 (continued)

No. of cores	Size (mm ²)	Conductor (wire/type)	Conductor diameter approx. (mm)	Insulation thickness nominal (mm)	Inner sheath thickness nominal (mm)	Dia. of inner sheath approx (mm)	Copper wire area (mm ²)	Outer sheath thickness nominal (mm)	Overall diameter approx. (mm)	Conductor resistance at 20°C maximum (Ohm/km)	Weight of cable approx. (kg/km)	Standard packing length (m)
3	16/6	7/Compacted	4.80	3.4	1.2	35.5	6	2.3	43.5	1.15	1800	500
3	25/6	7/Compacted	6.00	3.4	1.3	38.5	6	2.4	46.5	0.727	2200	500
3	35/10	7/Compacted	7.10	3.4	1.3	40.5	10	2.5	49.0	0.524	2600	500
3	50/10	19/Compacted	8.30	3.4	1.4	43.5	10	2.6	52.0	0.387	3100	500
3	70/10	19/Compacted	9.90	3.4	1.5	47.5	10	2.7	56.0	0.268	3900	500
3	70/16	19/Compacted	9.90	3.4	1.5	47.5	16	2.7	56.0	0.268	4000	500
3	95/16	19/Compacted	11.70	3.4	1.5	51.5	16	2.8	60.0	0.193	4900	500
3	120/16	37/Compacted	13.20	3.4	1.6	55.0	16	3.0	64.5	0.153	6000	500
3	150/25	37/Compacted	14.60	3.4	1.7	58.0	25	3.1	68.0	0.124	7000	300
3	185/25	37/Compacted	16.30	3.4	1.7	62.5	25	3.2	72.5	0.0991	8000	300
3	240/25	61/Compacted	18.70	3.4	1.8	68.0	25	3.4	78.0	0.0754	10000	300
3	240/35	61/Compacted	18.70	3.4	1.8	68.0	35	3.4	78.0	0.0754	10500	300
3	300/35	61/Compacted	20.90	3.4	1.9	73.0	35	3.6	83.5	0.0601	12500	300
3	400/35	61/Compacted	23.50	3.4	2.0	79.0	35	3.8	90.0	0.0470	15000	100